



△ NON PAVED

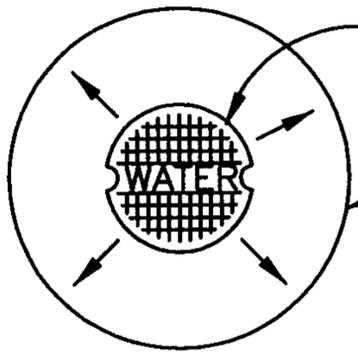


COVER-CLOW F-2493
"STAY-PUT" TYPE
(OR CITY APPROVED EQUAL) △

4' DIA x 6" THICK
CONCRETE APRON WITH 2%
TAPER IN NON-PAVED AREA △

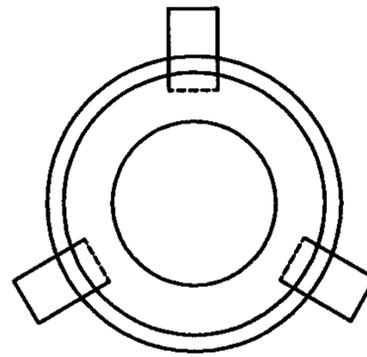

SET BASE ON BRICK
OR FLAT STONE AFTER
BACKFILLING PIPE △

PLAN

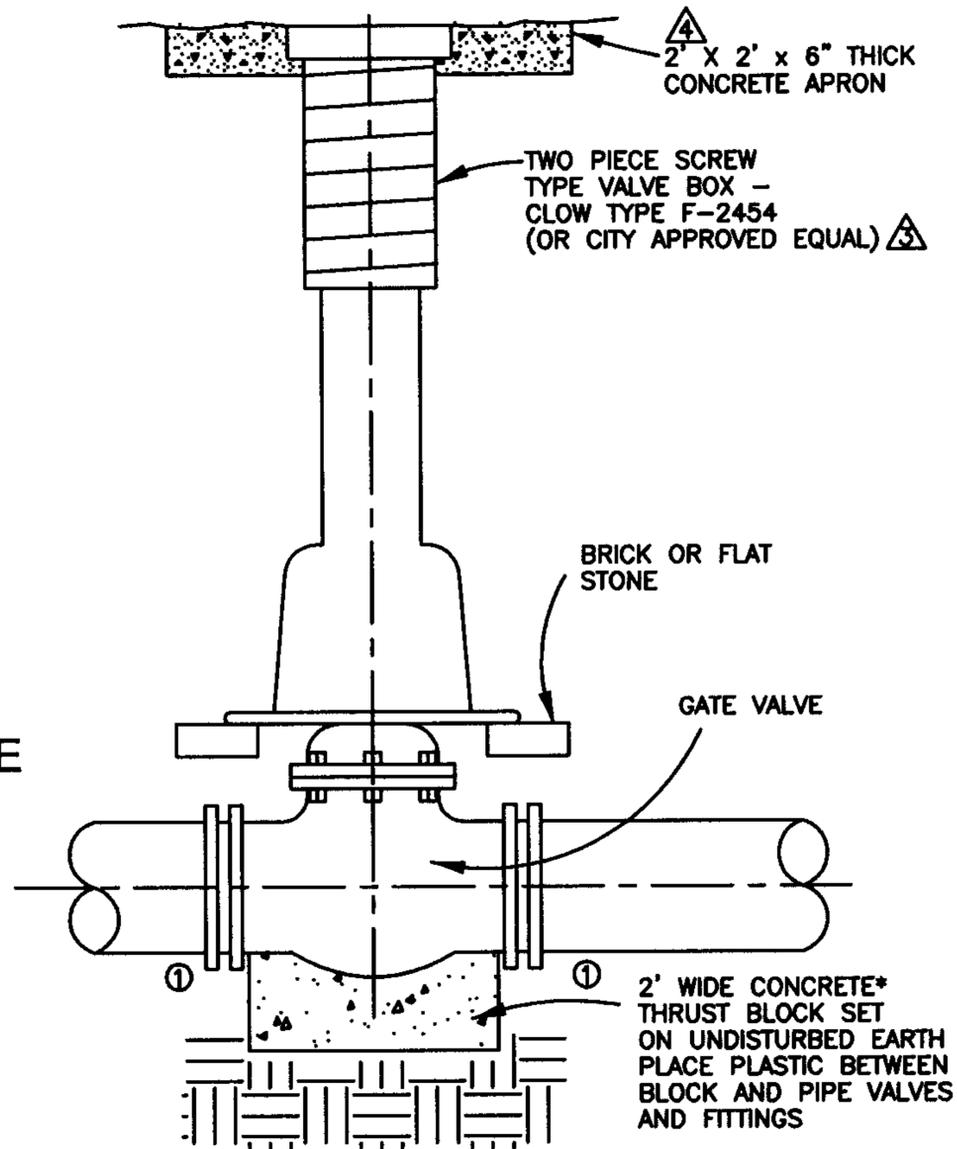

△ 2' X 2' x 6" THICK
CONCRETE APRON

TWO PIECE SCREW
TYPE VALVE BOX -
CLOW TYPE F-2454
(OR CITY APPROVED EQUAL) △

BRICK OR FLAT
STONE

GATE VALVE

① 2' WIDE CONCRETE*
THRUST BLOCK SET
ON UNDISTURBED EARTH
PLACE PLASTIC BETWEEN
BLOCK AND PIPE VALVES
AND FITTINGS

△ GATE VALVE
OR BUTTERFLY VALVE

NOTE

① MEG-A-LUG WEDGE ACTION
JOIST RESTRAINT, SERIES - 1100
FOR CAST IRON OR DUCTILE,
SERIES - 1100 PV FOR
CAST IRON SIZE PVC (TYPICAL)

SECTION

△ *PRE-MIXED CONCRETE BAGS MAY
BE USED WITH CITY ENGINEER
APPROVAL.

REV.	DATE
△	1/20/99
△	11/19/04
△	12/02/05
△	1/22/08

CONSTRUCTION
STANDARDS

VALVE INSTALLATION

STANDARD No. D-203 SHEET 1 OF 1

CITY OF
FARMINGTON

PUBLIC
WORKS
DEPARTMENT

APPROVED *[Signature]* DATE 4/15/08